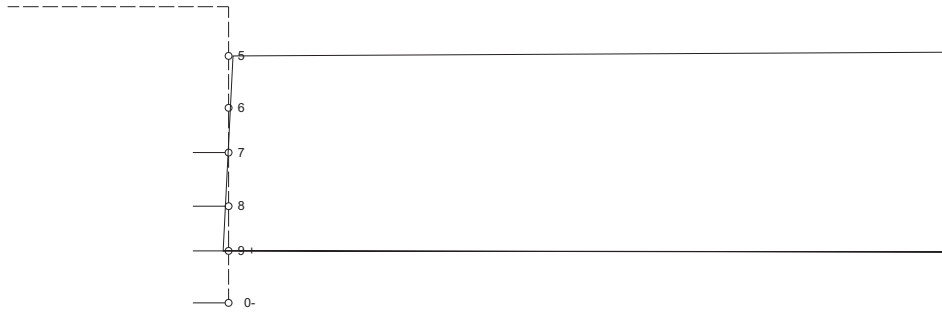

5
6
7
8
9
0-

- The apparatus must be installed, connected and adjusted by qualified personnel in non-hazardous area according with the instruction manual.
- The operator must strictly comply with the relevant local safety standards and guidelines.

➔ Supplementary instructions

- Our company reserves the right to change the product information without prior notification to the user. If the contents of the description are different from website or sample, this description shall prevail.

Vertically installation

➔ Light indication

- **PWR**: Power indicator light shows green, it means work normally.
- **OUT1**、**OUT2**: Bi-color LED
  Red LED flashing: Input short-circuit or linebreakage;
  Yellow LED ON: The relay is energized;
  Yellow LED OFF: The relay is de-energized.

➔ Attention

- Isolated Safety Barriers degree of protection is IP 20 and must be protected from undesirable ambient conditions (waterproofing, small foreign objects). It is suitable for installation in the control room or high density field cabinet, DIN 35 mm installation is convenient for installation and displacement.
- The devices were designed for use in pollution degree 2 and overvoltage category III as per IEC/EN 60664- . If used in areas with higher pollution degree, the devices need to be protected accordingly.
- Installation